



REQUEST FOR QUOTATION

PR No. : 1122-007

DATE : _____

JO No. : _____

Name of Company: _____
 Address: _____
 Business Permit No: _____
 TIN No.: _____

Please quote your best offer for the item/s described below, subject to the Terms and Conditions provided at the dorsal portion of this Request for Quotation. Submit your quotation duly signed by you or your duly authorized representative not later than _____, 2022.

JINKY P. MORENO
 Procurement Assistant A

After having carefully read and accepted the Terms and Conditions below, I/we submit our quotation/s for the item/s as follows:

| ITEM # | ITEM DESCRIPTION | Approved Budget of the Contract | OFFER | | | | | | | |
|--------|--|---------------------------------|-------|------|------------|-------|--|--------------------------|--------------------------|--|
| | | | PRICE | | | | Compliance with technical specifications | | REMARKS | |
| | | | QTY. | UNIT | UNIT PRICE | TOTAL | YES | NO | | |
| | PhP: _____ | 0.00 | | | | | | | | |
| 1 | COUPLING, COUPLING 250MM SLEEVE TYPE GI (SEE ATTACHED SPECIFICATION) | | 5.00 | pc | | | | <input type="checkbox"/> | <input type="checkbox"/> | |
| 2 | PIPE, PIPE 250MM X 6M GI SCHED.40 (SEE ATTACHED SPECIFICATION) | | 10.00 | pc | | | | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3 | VALVE, GATE VALVE 250 MJ/MJ (MS-NRS) (SEE ATTACHED SPECIFICATION) | | 1.00 | pc | | | | <input type="checkbox"/> | <input type="checkbox"/> | |

GRAND TOTAL: _____

Signature Over Printed Name: _____

Contact Number (Landline/Cellphone)/Email Address _____

Please submit the following requirements:

- Mayor's Permit
- Professional License/Curriculum (Consulting Services)
- Philgeps Registration Number
- PCAB License (Infra)
- Income Business Tax Return
- Omnibus Sworn Statements
- MANUFACTURER'S PMS & PII CERTIFICATE

OTHER TERMS AND CONDITIONS:

1. The mode of payment is within Six (6) months Three (3)months Two (2)months One (1)month.
2. Bidders shall provide correct and accurate information required in this form.
3. Bidders may quote for any at all times except for one (1) lot requisition.
4. Price quotation/s must have:
 - validity - Thirty (30) Calendar days
 - inclusion of tax
 - Quotations exceeding the Approved Budget for the Contract shall be rejected.
 - Award of contract shall be made to the lowest quotation (for goods and services)
 - Erasures or overwriting is not allowed unless signed by duly authorized representative/s.
5. The item/s shall be delivered within Thirty (30) days / months from receipt of Notice to Proceed (NTP) with Purchase Order & Notice of Award (NOA) and Job Order Contract & Notice of Award (NOA).
6. The awardee shall notify two (2) days before its delivery of goods and services.
7. The MKWD shall have the right to inspect and/or to test the goods to confirm their conformity to the technical specifications.
8. Liquidated damages equivalent to one tenth of one percent (0.001%) of the value of the goods not delivered within the prescribed delivery period shall be imposed per day of delay. The MKWD shall rescind the contract once the cumulative amount of liquidated damages reaches ten percent (10%) of the amount of the contract, without prejudice to other courses of action and remedies open to it.



Republic of the Philippines
METRO KIDAPAWAN WATER DISTRICT
 Lanao, Kidapawan City
 Tel nos. (064)577-1533, 577-1865, Fax no. (064) 572-5555
 E-mail Address: metrokidapawan_wd@yahoo.com
 Website: www.metrokidapawanwd.gov.ph
"Committed to Service, Development and Self-Reliance"





TERMS OF REFERENCE

| | | | |
|---|---|-----------|-------------------------------|
| PURPOSE | EWO-LAPAAN DAM 3 | | |
| PARTICULARS | <input checked="" type="checkbox"/> PR <input type="checkbox"/> JO No.: | 1122- 007 | Date: October 11, 2022 |
| ITEMS, SPECIFICATIONS, AND DESCRIPTIONS | | | |
| ITEM 1 | 5 units Coupling Sleeve Type for G.I 250mmØ | | |
| SPECIFICATIONS: 1 (Please see attached specification) | | | |
| ITEM 2 | 10 units Pipe 250mm x 6.0m G.I Sch 40 | | |
| SPECIFICATIONS: 1 (Please see attached specification) | | | |
| ITEM 3 | 1 unit Valve Gate 250mmØ MJ/MJ (MS-NRS) | | |
| SPECIFICATIONS: 1 (Please see attached specification) | | | |

Note: For more than 6 items attach separate TOR Form. For More specifications attach necessary supporting document/s.

| | | |
|---|--|---------------------|
| SOURCE OF FUND | APP/PPMP Item No.: | |
| | Account No.: | NDRRMC FUND P56.56M |
| MODES AND TERMS OF PAYMENT | Full payment within six months upon issuance of I.A.R | |
| REQUIRED SERVICES | | |
| <input checked="" type="checkbox"/> Free Delivery | Others specify: | |
| <input type="checkbox"/> Free Product Demonstration | | |
| <input type="checkbox"/> Free Installation | | |
| REQUIRED CERTIFICATIONS/ PERMITS | None | |
| QUALIFICATIONS | | |
| AREA OF DELIVERY | MKWD Manongol Reservoir Complex, Brgy. Manongol, Kidapawan City | |
| DATE OF DELIVERY | within 30 DAYS upon issuance of NOA/NTP | |
| TIME OF DELIVERY | 9:00AM TO 4:00PM every weekdays | |
| WARRANTY PERIOD | POST INSPECTION WILL BE CONDUCTED AS REQUIREMENT FOR PAYMENT PREPARATION | |
| RETENTION | Amount: | n/a |
| | Duration: | n/a |
| TAX INCLUSIVE | Tax included in ABC | |
| OTHER CONDITIONS AND CONSTRAINTS | | |
| Materials found to be defective and/or materials that are non-compliant to the standards or specification set upon delivery must be replace at the expense of the supplier. | | |
| Prepared by: | Reviewed by: | |
| KELVIN E. RUPISAN, CE Division Manager A-PDD | RAMIL A. CONDEZ, CE, RMP, MBA Department Manager A - ECD | |
| Noted by: | Approved/Disapproved by: | |
| WILESPER LISANDRO M. ALQUEZA, CE, RMP, MBA AGM for Operations | STELLA M. GONZALES, MPS General Manager | |

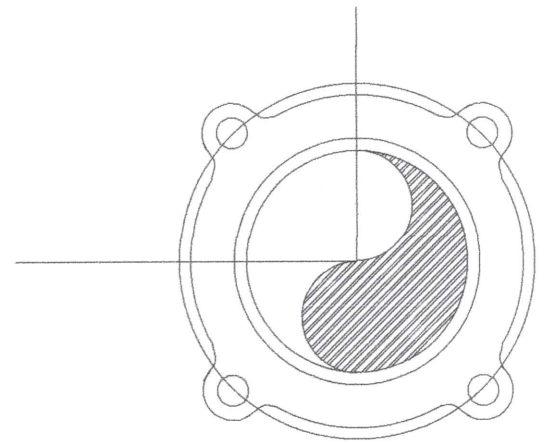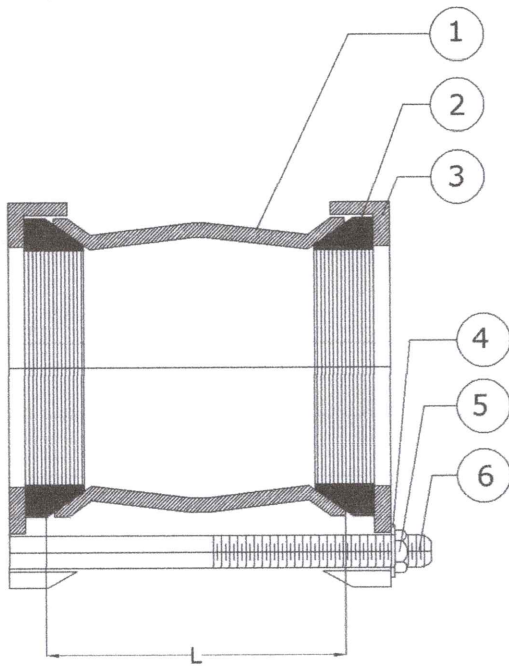

RIGHT SIDE VIEW

C.I SLEEVE TYPE COUPLING

PARTS:

1. BODY SLEEVE
2. RUBBER SEAL
3. GLAND RING
4. WASHER
5. NUTS
6. BOLTS

MATERIALS:

- CAST IRON
 RUBBER
 CAST IRON
 STEEL
 STEEL
 STEEL

ASTM

- ASTM A-126 CLASS B
 EPDM, NBR, SBR
 ASTM A-126 CLASS B
 ASTM A-307 GRADE B
 ASTM A-307 GRADE B
 ASTM A-307 GRADE B

| NOMINAL SIZE | OUTSIDE DIAMETER PVC | L | T |
|--------------|----------------------|-----|---|
| 50 | 50 | 178 | 5 |
| 63 | 63 | 178 | 5 |
| 75 | 75 | 178 | 5 |
| 100 | 100 | 178 | 5 |
| 150 | 150 | 178 | 5 |
| 200 | 200 | 178 | 6 |
| 250 | 250 | 178 | 6 |
| 300 | 300 | 178 | 6 |

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETER UNITS
2. MATERIAL IS CAST IRON CONFORM TO ASTM A-125 CLASS B
3. MATERIAL OF BOLTS NUTS & WASHER ARE STEEL CONFORM TO ASTM A-307 GRADE B, ASTM A-563 RESPECTIVELY AND HOT DIP GALVANIZED AS PER ASTM A-153
4. INTERIOR & EXTERIOR COATING IS EXPOXY POWDER

TECHNICAL STANDARD DETAILS



PLANNING AND DESIGN DIVISION
 OF METRO KIDAPAWAN WATER DISTRICT


C.I SLEEVE TYPE COUPLING

DATE: FEBRUARY 2021

DWG. NO.: 01

SCALE: N.T.S BY: DESIGN UNIT

| REVISIONS | |
|-----------|------|
| BY | DATE |
| | |
| | |
| | |

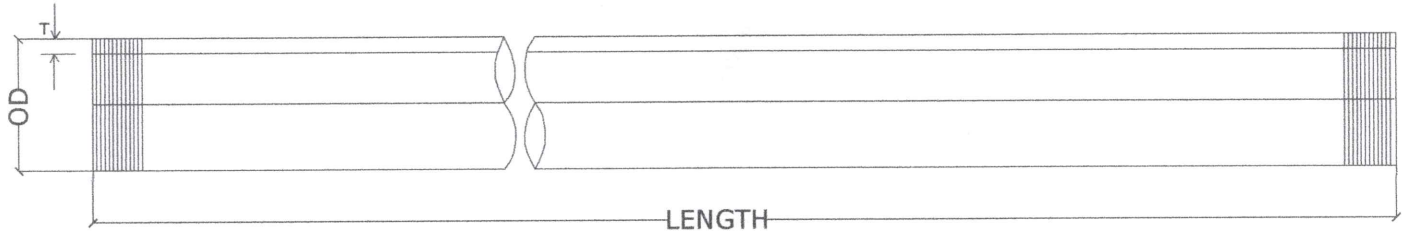

GALVANIZED IRON (G.I) PIPES

| NOMINAL PIPE SIZE | OUTSIDE DIAMETER (mm) | THICKNESS (mm) | Weight per Ft (lb) | EFFECTIVE LENGTH |
|-------------------|-----------------------|----------------|--------------------|------------------|
| 50mm | 60.325 | 3.912 | 3.652 | 6 meters |
| 75mm | 88.9 | 5.50 | 7.575 | 6 meters |
| 100mm | 114.3 | 6.02 | 10.790 | 6 meters |
| 150mm | 168.3 | 7.112 | 18.974 | 6 meters |
| 200mm | 219.075 | 8.20 | 28.554 | 6 meters |
| 250mm | 273.05 | 9.271 | 40.483 | 6 meters |
| 300mm | 323.85 | 9.53 | 49.562 | 6 meters |

Schedule: 40


Jointing Method: Welding

MATERIAL

G.I. MATERIAL IS IN ACCORDANCE TO ASTM A123 Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products

TECHNICAL STANDARD DETAILS

| | | | | | |
|--|---|-----------------|------------------------|------------------------|-----------|
| | PLANNING AND DESIGN DIVISION OF METRO KIDAPAWAN WATER DISTRICT | | GALVANIZED IRON PIPES | | REVISIONS |
| | SCALE: N.T.S | BY: DESIGN UNIT | DATE: FEBRUARY 2021 | DWG. NO.: 01 | BY |

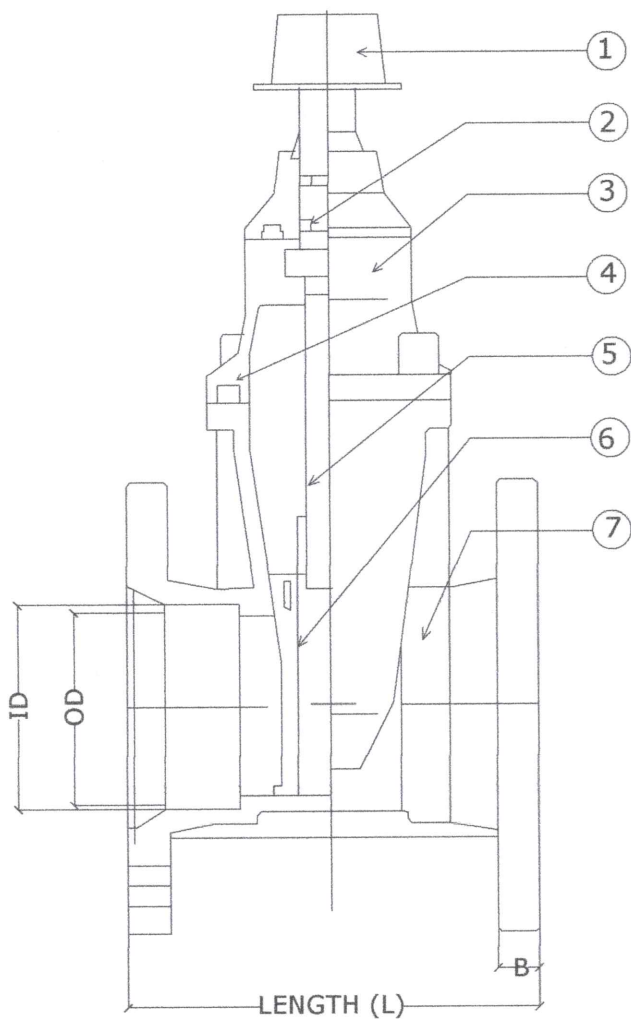

- COMPONENT
1. OPERATING NUT
 2. O-RING
 3. BONNET
 4. GASKET BONNET
 5. STEM
 6. WEDGE
 7. VALVE BODY

C.I GATE VALVE MECHANICAL JOINT TYPE

| DN | OUTSIDE DIAMETER (OD) | INSIDE DIAMETER (ID) | LENGTH (L) | B |
|-----|-----------------------|----------------------|------------|------|
| 50 | 63 | 65 | 178 | 15.9 |
| 63 | 75 | 79 | 178 | 15.9 |
| 75 | 90 | 94 | 203 | 19.1 |
| 100 | 110 | 114 | 229 | 19.1 |
| 150 | 160 | 164 | 267 | 19.1 |
| 200 | 225 | 229 | 291 | 20.0 |
| 250 | 280 | 284 | 330 | 20.0 |

NOTES:

1. TECHNOLOGY CONDITION ON DESIGN AND MANUFACTURE IN CONFORMITY TO ANSI/AWWA C-509-1994.
2. RESILIENT SEATED WEDGE MADE OF DUCTILE IRON WITH ASTM A-536
3. 50mm SQUARE OPERATING NUT WITH ARROW MARK FOR OPENING DIRECTION.
4. COUNTERCLOCKWISE OPENING DIRECTION
5. RATED WORKING PRESSURE 16 BARS MINIMUM
6. COATING & LINING SHALL CONFORM TO AWWA C-550 ELECTROSTATICALLY APPLIED EPOXY POWDER OR EQUIVALENT.
7. GATE VALVE SHOULD BE NON-RISING STEM (NRS)

TECHNICAL STANDARD DETAILS

| | | | | | |
|--|---|-----------------|-----------------------------------|-----------------|----------------------------|
| | PLANNING AND DESIGN DIVISION OF METRO KIDAPAWAN WATER DISTRICT | | C.I GATE VALVE MECHANICAL TYPE | | REVISIONS BY DATE |
| | SCALE: N.T.S | BY: DESIGN UNIT | DATE: FEBRUARY 2021 | DWG. NO.: 01 | (Empty grid for revisions) |